



SOUTH FEATHER WATER & POWER AGENCY

TO: Board of Directors

FROM: Matt Colwell, Water Division Manager

DATE: March 28, 2006

RE: General Information (regarding matters not scheduled on agenda)

Distribution Operations

Water Division staff have been accomplishing water distribution system maintenance and betterment projects including new office construction, service installations, leak repairs, and irrigation and domestic distribution system betterments.

Water Treatment Operations

Water Plant Production: The MRTTP production (system demand) for February is 91-percent of average for the recent 5-year period and the annual production is 89-percent of average


Bacteriological requirements were met for the Miners Ranch Treatment Plant and Bangor Treatment Plant.

Solar Plant Production:

The graph at right provides a perspective of energy consumption compared to water production. February solar energy production exceeded the Plant demand by 3,000 kwh.

Miners Ranch February 2006	
Total	65.7 Million Gallons
High	3.1 MGD
Low	1.9 MGD
Avg.	2.4 MGD
Bangor	
Total	0.18 Million Gallons
High	0.03 MGD
Low	0.00 MGD
Avg.	0.02 MGD

**Miners Ranch Water Treatment Plant
Monthly Water Production VS: KWH Purchased**

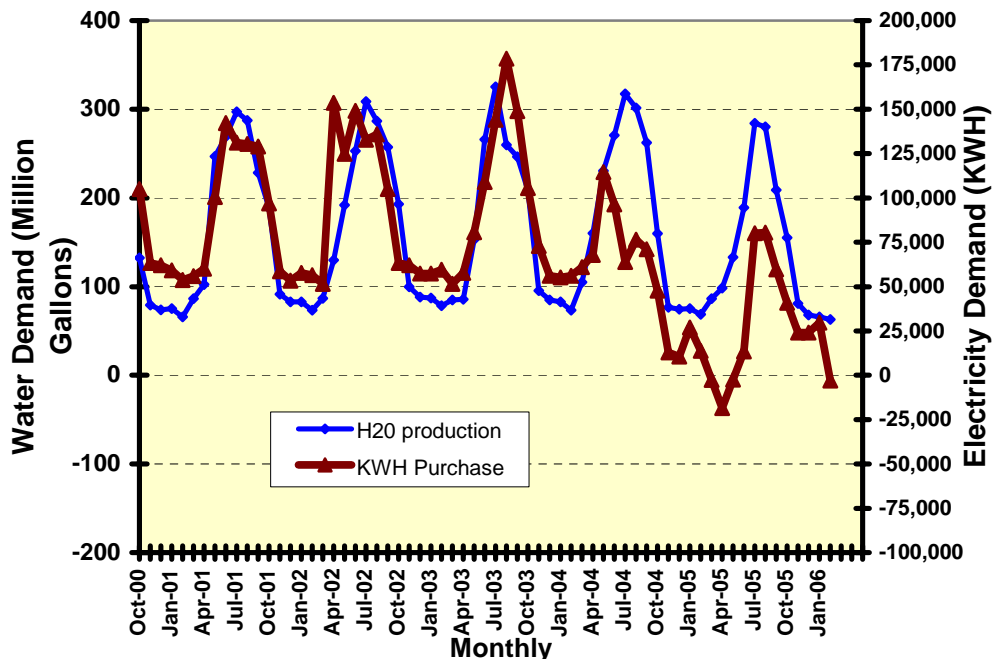

M RTP Total Annual Water Production

